

6





5

4

3

2

1

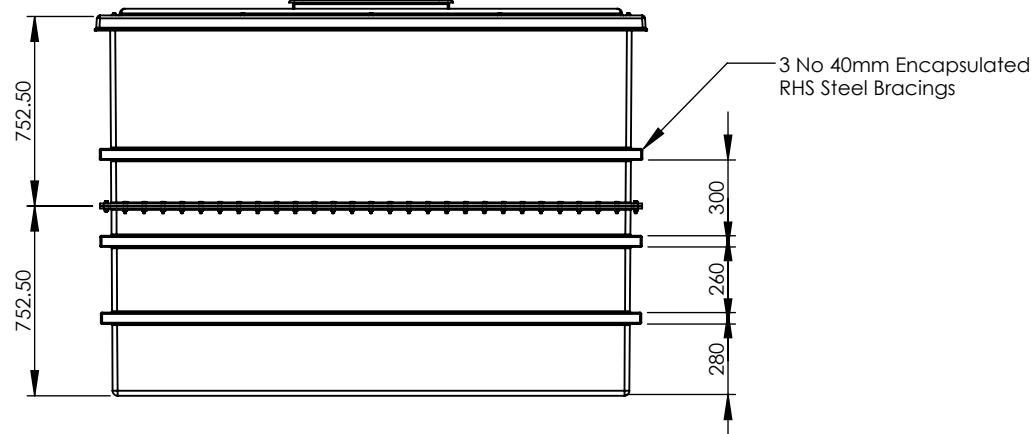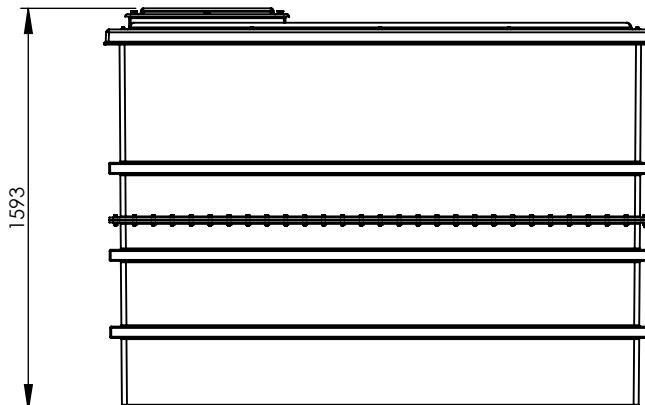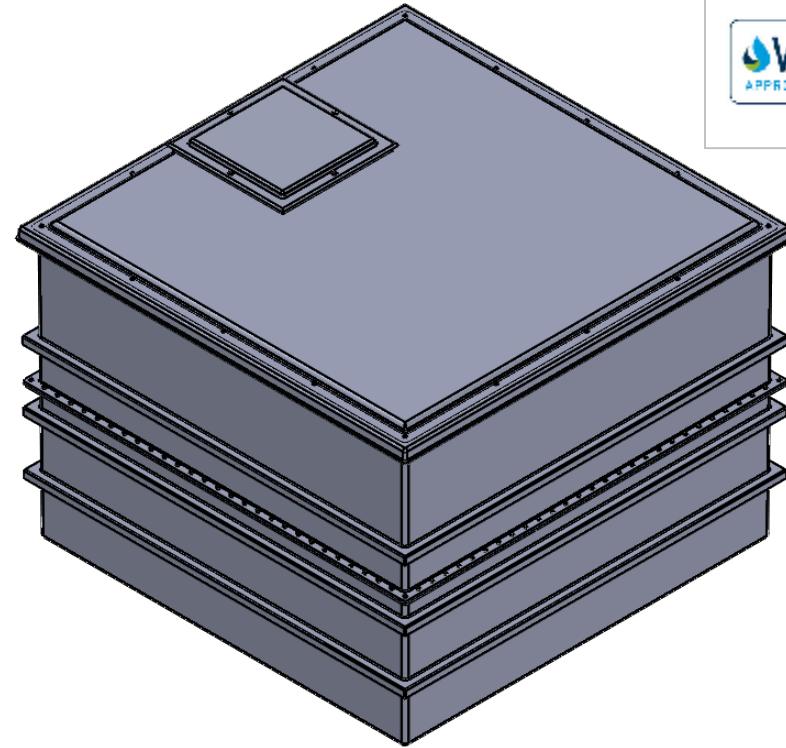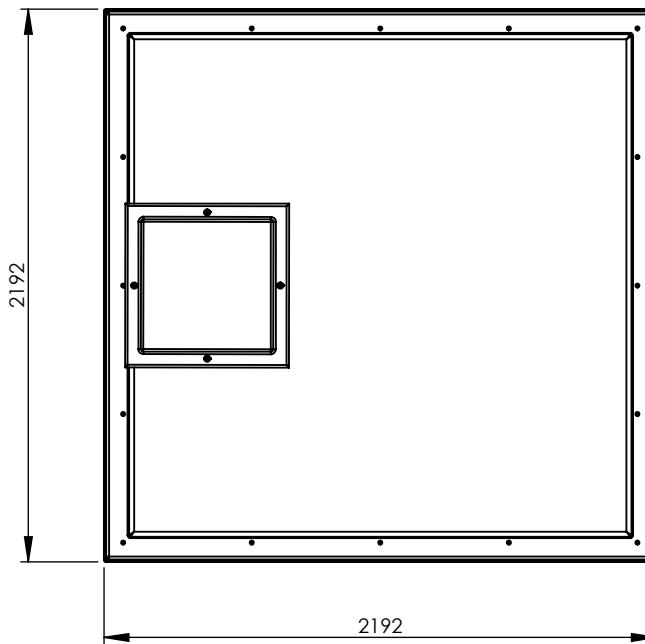

A

TITLE
PW6001.INS-2.AG

NOTE:

All Purewater tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

DRAWN BY C.MORRIS DATE 05/12/2017

CUSTOMER

ALL DIMENSIONS +/- 5mm
UNLESS OTHERWISE STATED

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

6

5

4

3

2

1

DESCRIPTION:

PW6001-2 piece cold water storage tank
suitable for AG/AF Air gap

DATE	VERSION	NOTES
06/11/2017	A	FIRST ISSUE

TANK SPECIFICATION :

INTERNAL DIMENSIONS	2000 x 2000 x 1500mm
EXTERNAL DIMENSIONS	2192 x 2192 x 1593mm
NOM. CAPACITY	6000 Litres
DRY WEIGHT	440 KG
INSULATION THICKNESS	25mm
WRAS CERT. NUMBER	131006
MATERIAL	GRP

purewater
Storage Ltd

SCALE:1:30 SHEET 1 OF 1