

6

5

△





3

1

1

D

D

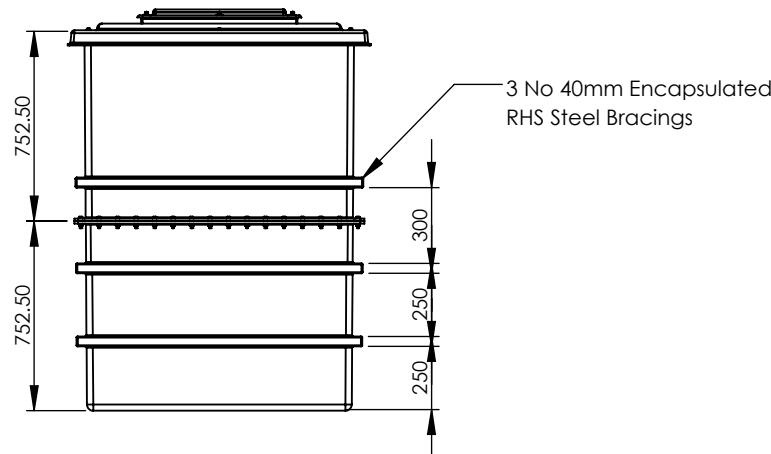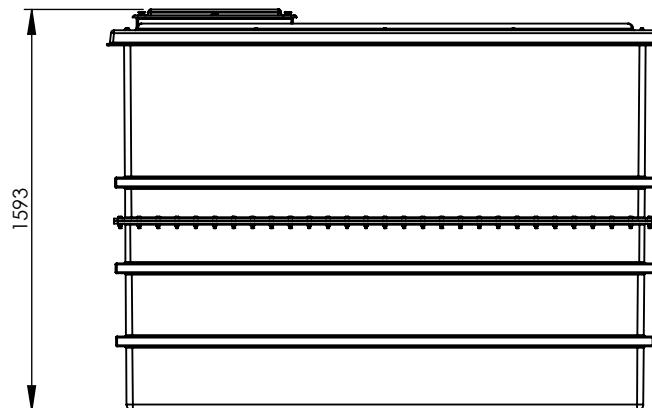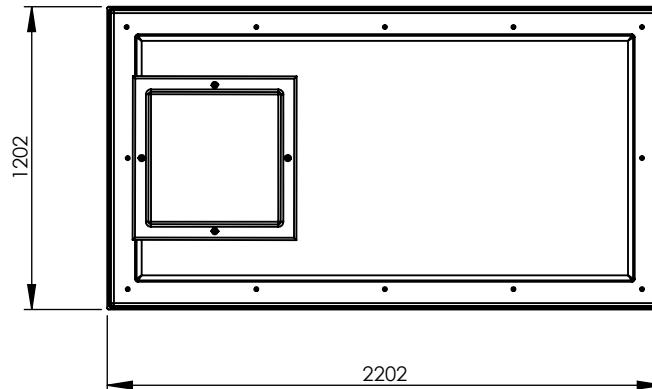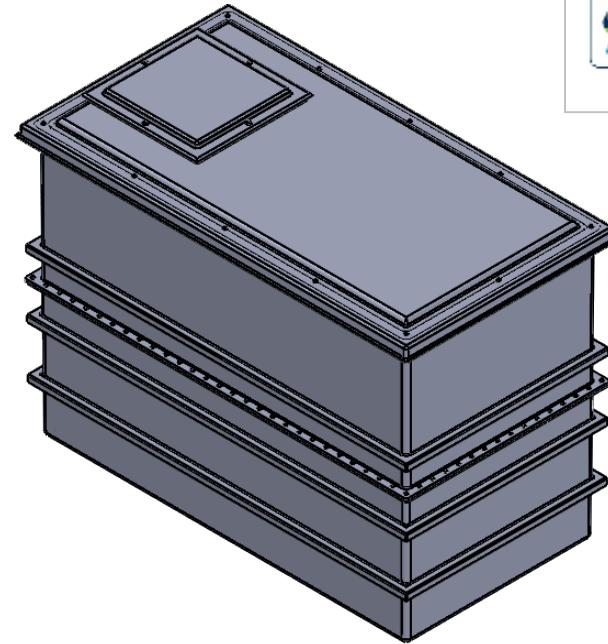

A

PW3001.INS-2.AG

NOTE:
All Purewater tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

DESCRIPTION

TANK SPECIFICATION

INTERNAL DIMENSIONS	2000 x 1000 x 1500mm
EXTERNAL DIMENSIONS	2202 x 1202 x 1593mm
NOM. CAPACITY	3000 Litres
DRY WEIGHT	195 KG
INSULATION THICKNESS	25mm
WRAS CERT. NUMBER	131006
MATERIAL	GRP

pure water storage ltd

1:30

SHEET 1 OF 1

6

5

△

3

10

1