

6




5

1

5

1

1

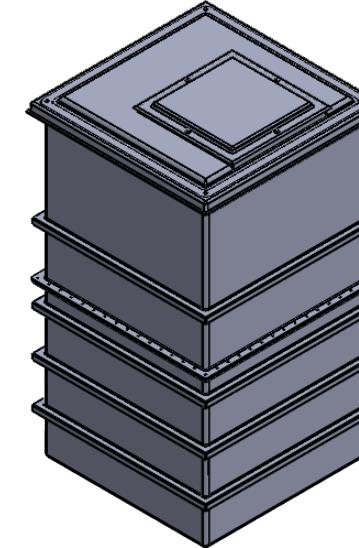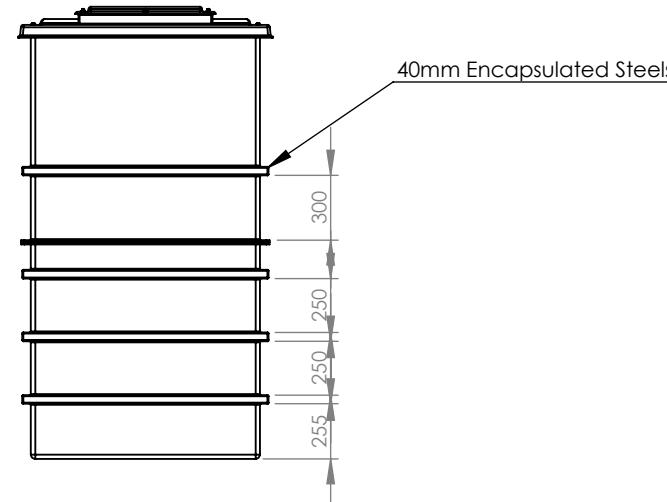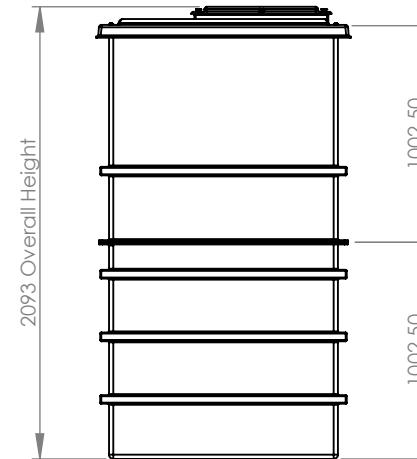

**TITLE**

PW2001.INS-2 (AG)

**NOTE:**

All Purewater tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

#### DESCRIPTION

PW2001-2 piece cold water storage tank  
suitable for AG/AF Air gap

DATE	VERSION	NOTES
14/12/2021	A	FIRST ISSUE

## TANK SPECIFICATION

INTERNAL DIMENSIONS	1000 x 1000 x 2000mm
EXTERNAL DIMENSIONS	1180 x 1180 x 2093mm
NOM. CAPACITY	2000 Litres
DRY WEIGHT	115 KG
INSULATION THICKNESS	25mm
WRAS CERT. NUMBER	131006
MATERIAL	GRP

pure water  
storage ltd.

SHEET 1 OF 1

6

5

1

5

1

1