

6

5

△



3

1

1



A technical line drawing of a double door unit. The unit consists of two doors: a smaller inner door and a larger outer door. The inner door is centered within the outer door. The overall width of the unit is indicated by a dimension line at the bottom right labeled '1700'. To the left of the unit, a vertical dimension line indicates a height of '1310' from the bottom to the top of the outer door frame. The doors are shown with double lines and small circular features representing handles or locks.

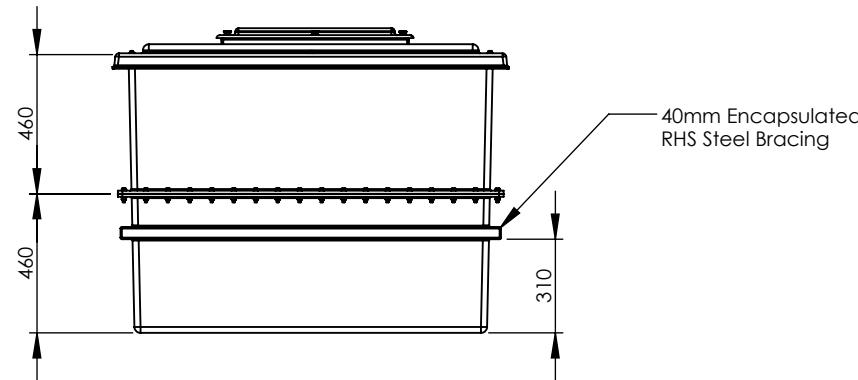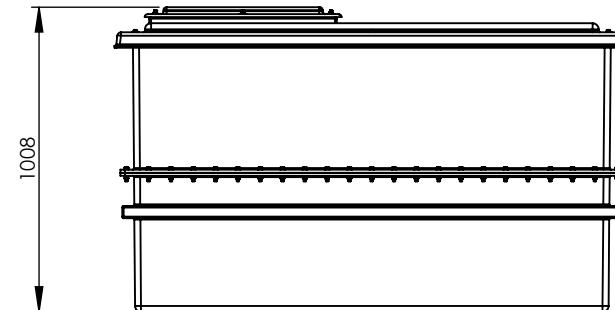

| | | | |
|-----------------|-----------------|--|------------|
| A | TITLE | NOTE: All Purewater tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank. | |
| DRAWN BY | C.MORRIS | DATE | 05/12/2017 |
| CUSTOMER | CUSTOMER | ALL DIMENSIONS+/- 5mm UNLESS OTHERWISE STATED | A4 |

DESCRIPTION:
PW1590-2 piece cold water storage tank
suitable for AG/AF Air gap

ALL DIMENSIONS IN MM - DO NOT SCALE

| DATE | VERSION | NOTES | TANK SPECIFICATION : | |
|------------|---------|----------------------|----------------------|--------------|
| 28/09/2017 | A | FIRST ISSUE | | |
| | | INTERNAL DIMENSIONS | 1524 x 1143 x 915mm | |
| | | EXTERNAL DIMENSIONS | 1700 x 1310 x 1008mm | |
| | | NOM. CAPACITY | 1590 Litres | |
| | | DRY WEIGHT | 115 KG | |
| | | INSULATION THICKNESS | 25mm | |
| | | WRAS CERT. NUMBER | 131006 | SCALE:1:25 |
| | | MATERIAL | GRP | SHEET 1 OF 1 |