

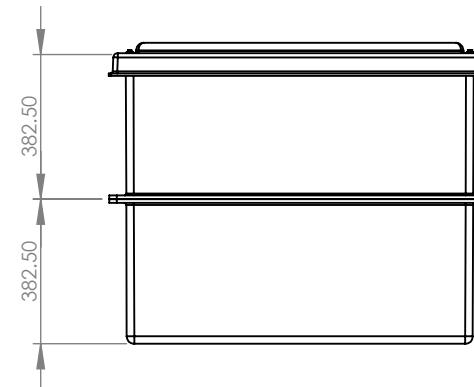
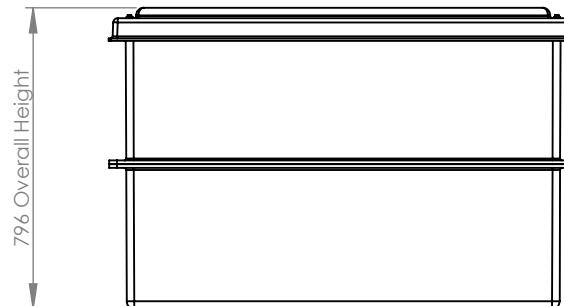


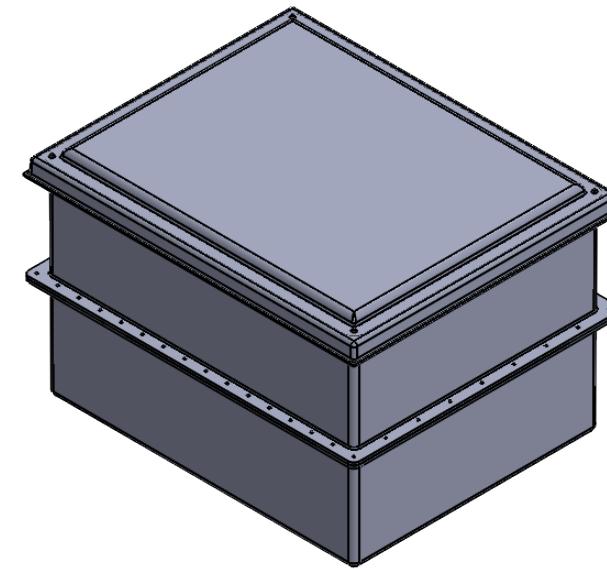

6 5 4 3 2 1

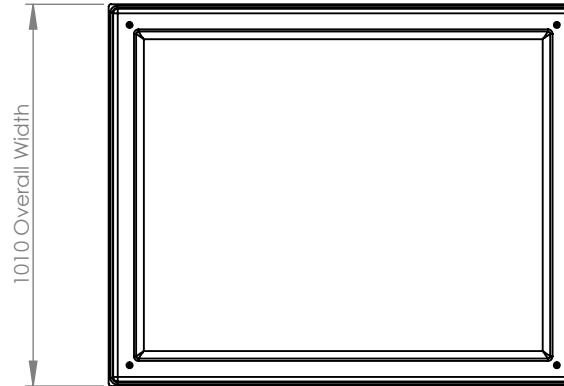

D

D

C

C

B

B

A

A

TITLE
PW712.INS-2 (AG)

NOTE:

All Purewater tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

DRAWN BY J. Ellison DATE 16/12/2021

CUSTOMER

ALL DIMENSIONS +/- 5mm
UNLESS OTHERWISE STATED

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE 16/12/2021 VERSION A NOTES FIRST ISSUE

TANK SPECIFICATION :		
INTERNAL DIMENSIONS	1090 x 860 x 760mm	
EXTERNAL DIMENSIONS	1240 x 1010 x 796mm	
NOM. CAPACITY	712 Litres	
DRY WEIGHT	45 KG	
INSULATION THICKNESS	25mm	
WRAS CERT. NUMBER	131006	
MATERIAL	GRP	

purewater
storage ltd

SCALE:1:20 SHEET 1 OF 1

6

5

4

3

2

1