

6

5

4



3

2


1

D

1202

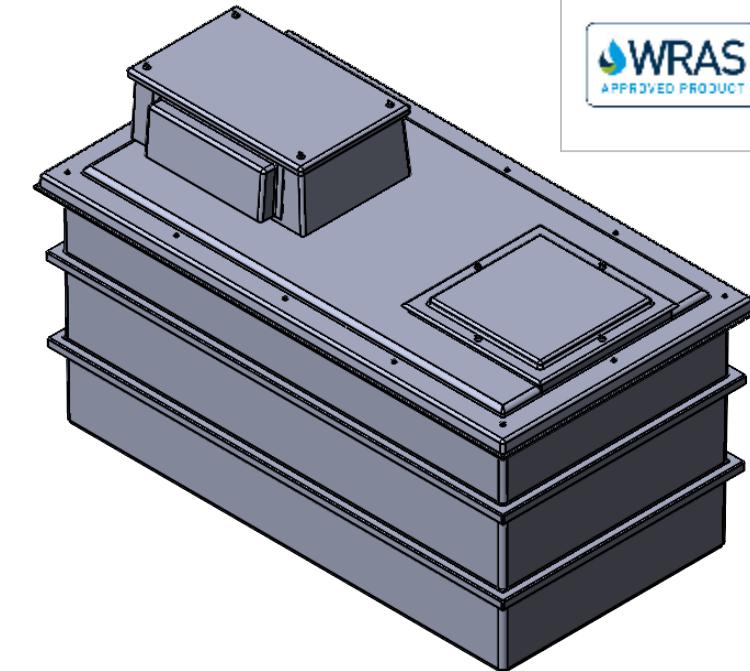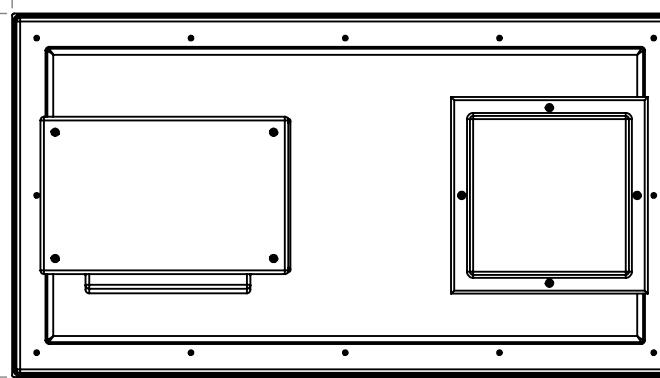

C

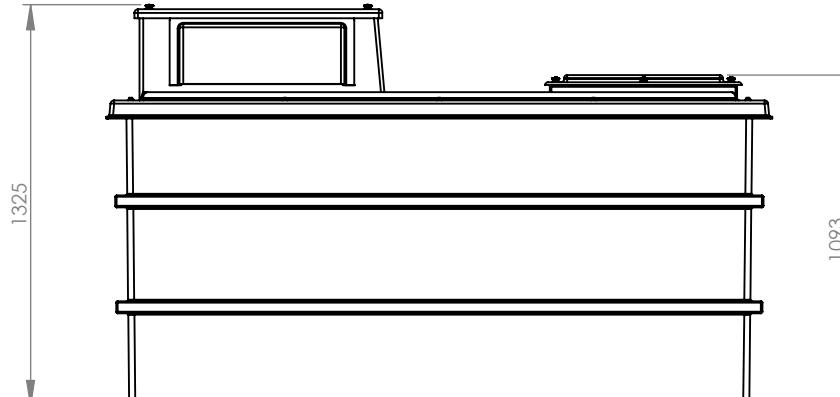

B

A

TITLE  
PW2000.INS.AB.4

## NOTE:

All Purewater tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

DRAWN BY J. Ellison DATE 15/05/2023

CUSTOMER

ALL DIMENSIONS +/- 5mm  
UNLESS OTHERWISE STATED

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

4

DATE 10/10/2017 VERSION A NOTES FIRST ISSUE

## TANK SPECIFICATION :

|                      |                      |
|----------------------|----------------------|
| INTERNAL DIMENSIONS  | 2000 x 1000 x 1000mm |
| EXTERNAL DIMENSIONS  | 2202 x 1202 x 1325mm |
| NOM. CAPACITY        | 2000 Litres          |
| DRY WEIGHT           | 148 KG               |
| INSULATION THICKNESS | 25mm                 |
| WRAS CERT. NUMBER    | 131006               |
| MATERIAL             | GRP                  |

purewater  
storage ltd

SCALE:1:25 SHEET 1 OF 1

3

2

1

6

5

4

3

2

1

D

C

B

A