
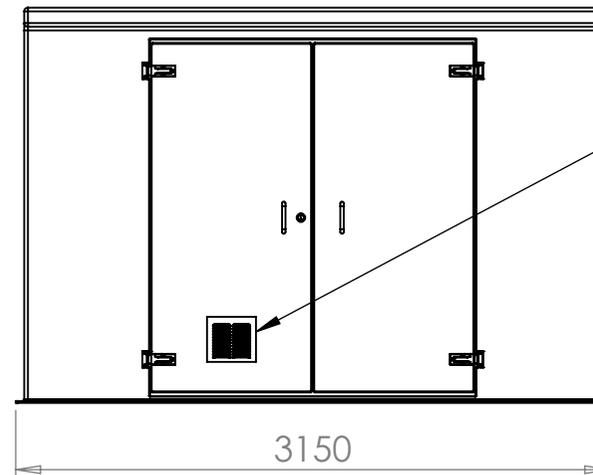


Sloped roof

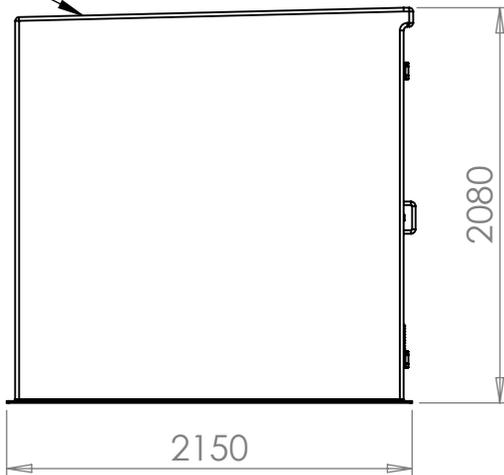

Louvered vent

TITLE		PWH12000	
DRAWN BY	J. Ellison	DATE	21/01/2022
CUSTOMER	CUSTOMER		

Foundation Requirements:	
The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.	
ALL DIMENSIONS+/- 5mm UNLESS OTHERWISE STATED	A4


DESCRIPTION:	
PWH12000 c/w Louvered vent	
ALL DIMENSIONS IN MM - DO NOT SCALE	

DATE	VERSION	NOTES
21/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	3000 x 2000 x 2000mm
EXTERNAL DIMENSIONS	3150 x 2150 x 2080mm
DRY WEIGHT	xxx KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:40 SHEET 1 OF 2

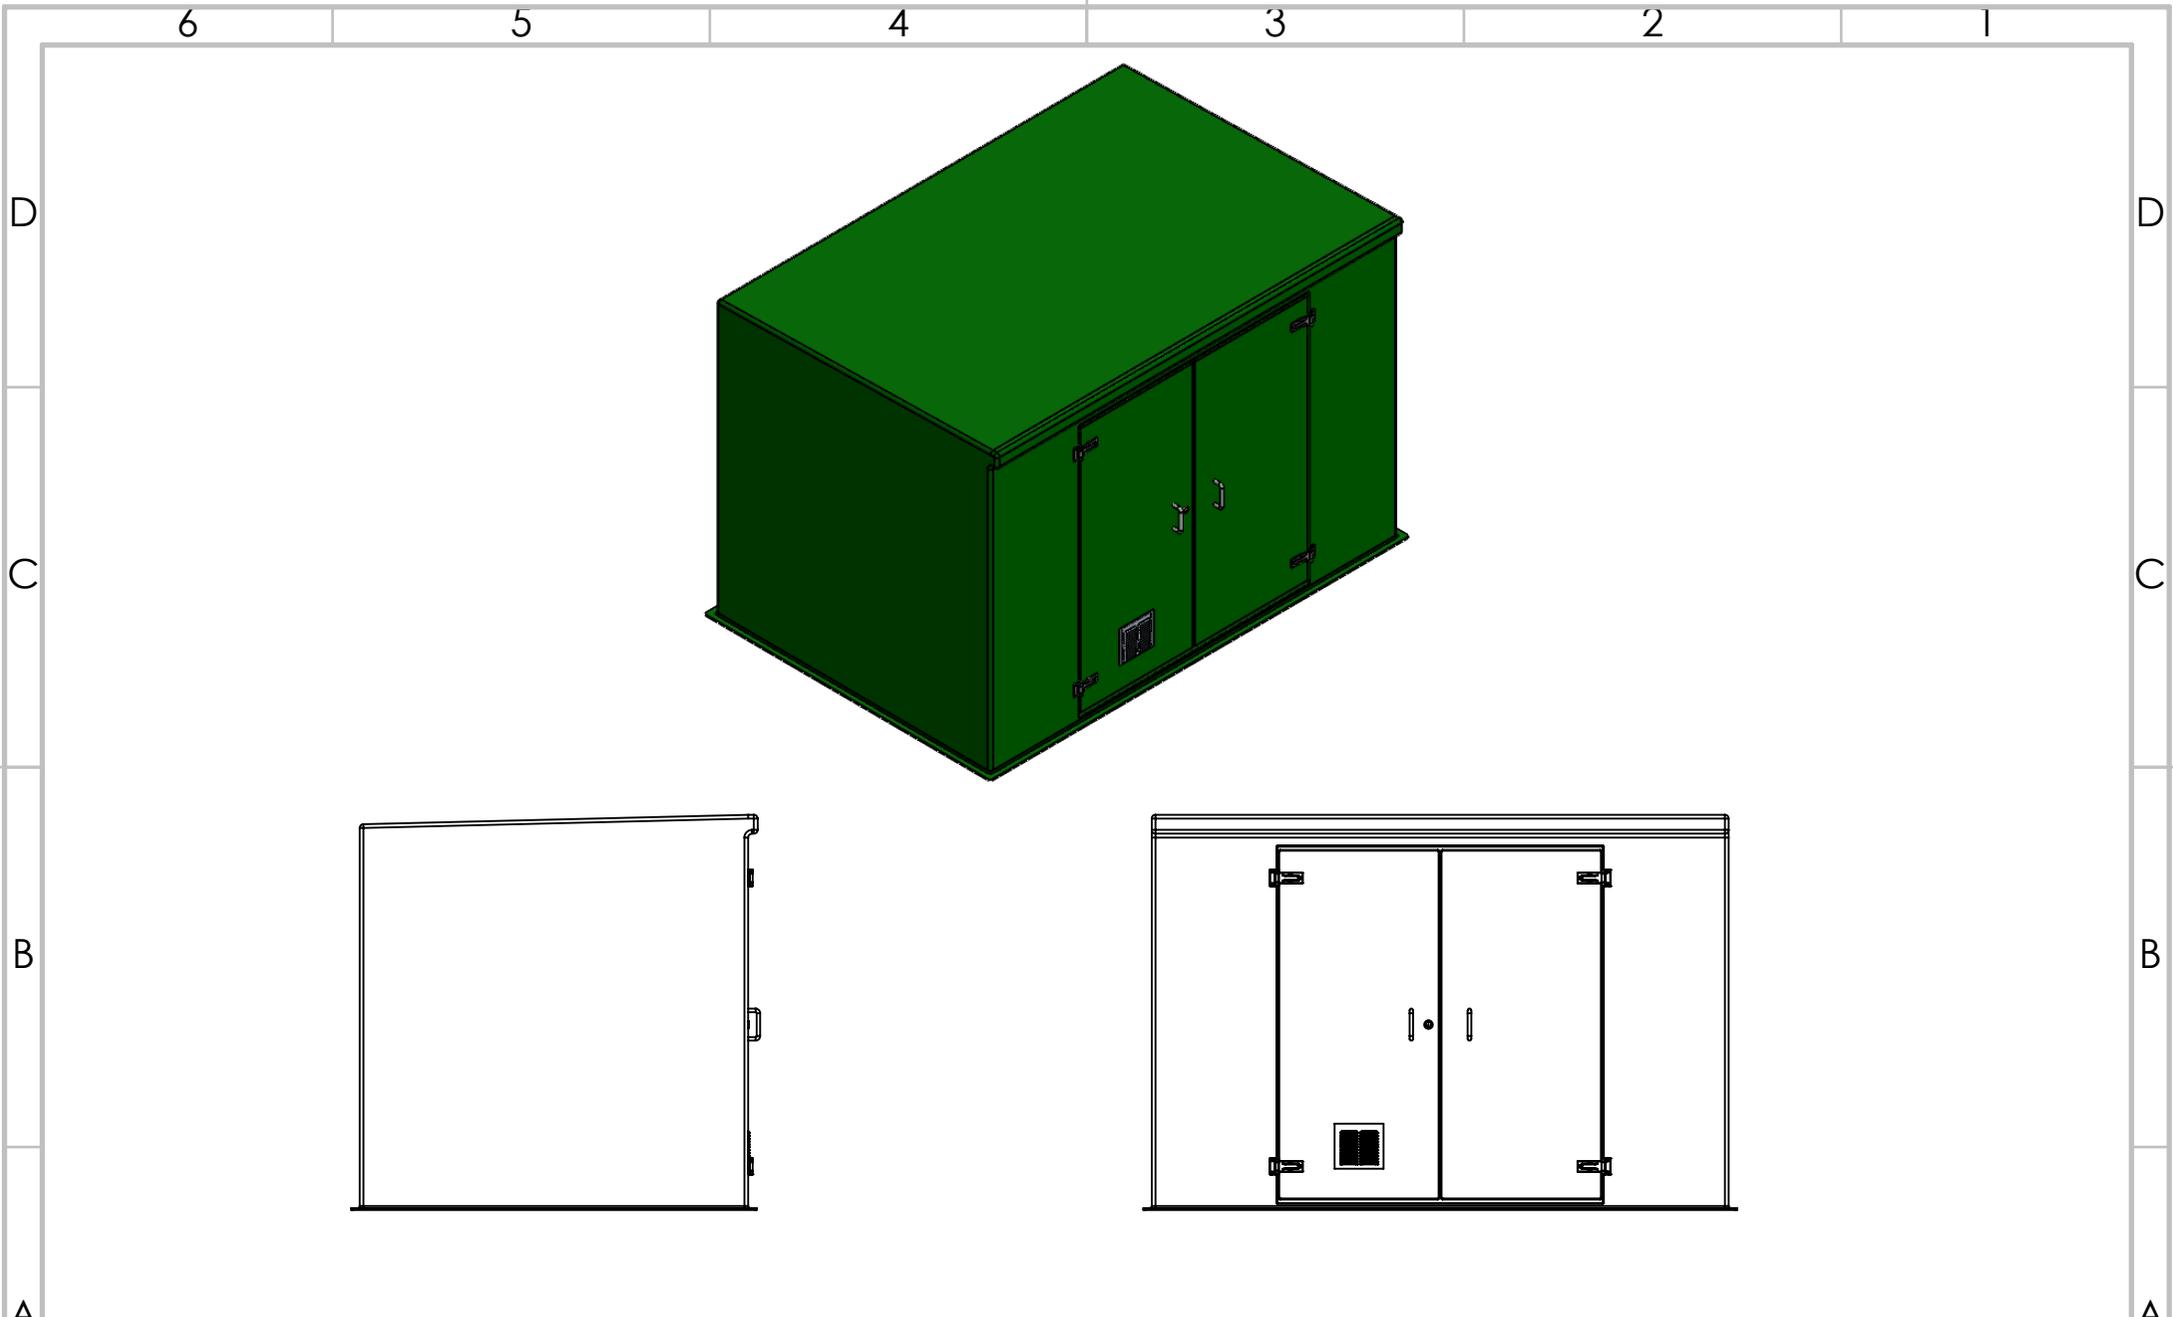

TITLE
PWH12000 Green

DRAWN BY
 J. Ellison

DATE
 21/01/2022

CUSTOMER
 CUSTOMER

Foundation Requirements:
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

ALL DIMENSIONS+/- 5mm
 UNLESS OTHERWISE STATED

DESCRIPTION:
 PWH12000 c/w Louvered vent, Green

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE	VERSION	NOTES
21/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	3000 x 2000 x 2000mm
EXTERNAL DIMENSIONS	3150 x 2150 x 2080mm
DRY WEIGHT	xxx KG
INSULATION THICKNESS	25mm
MATERIAL	GRP

pure water storage ltd

SCALE:1:40

SHEET 2 OF 2