
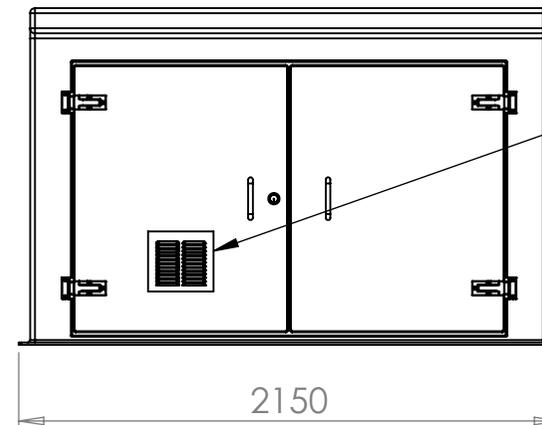


Sloped roof

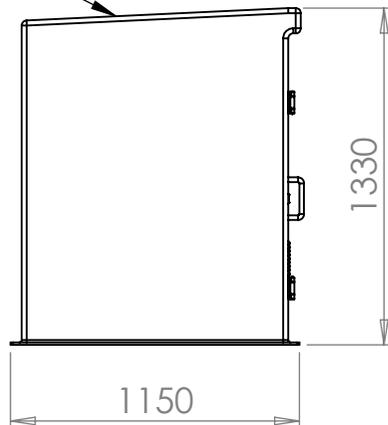

Louvered vent

TITLE	PWH2501	
DRAWN BY	J. Ellison	DATE 21/01/2022
CUSTOMER	CUSTOMER	

Foundation Requirements:
The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.
ALL DIMENSIONS +/- 5mm UNLESS OTHERWISE STATED


DESCRIPTION:	PWH2501 c/w Louvered vent
ALL DIMENSIONS IN MM - DO NOT SCALE	

DATE	VERSION	NOTES
21/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	2000 x 1000 x 1250mm
EXTERNAL DIMENSIONS	2150 x 1150 x 1330mm
DRY WEIGHT	178 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:30 SHEET 1 OF 2

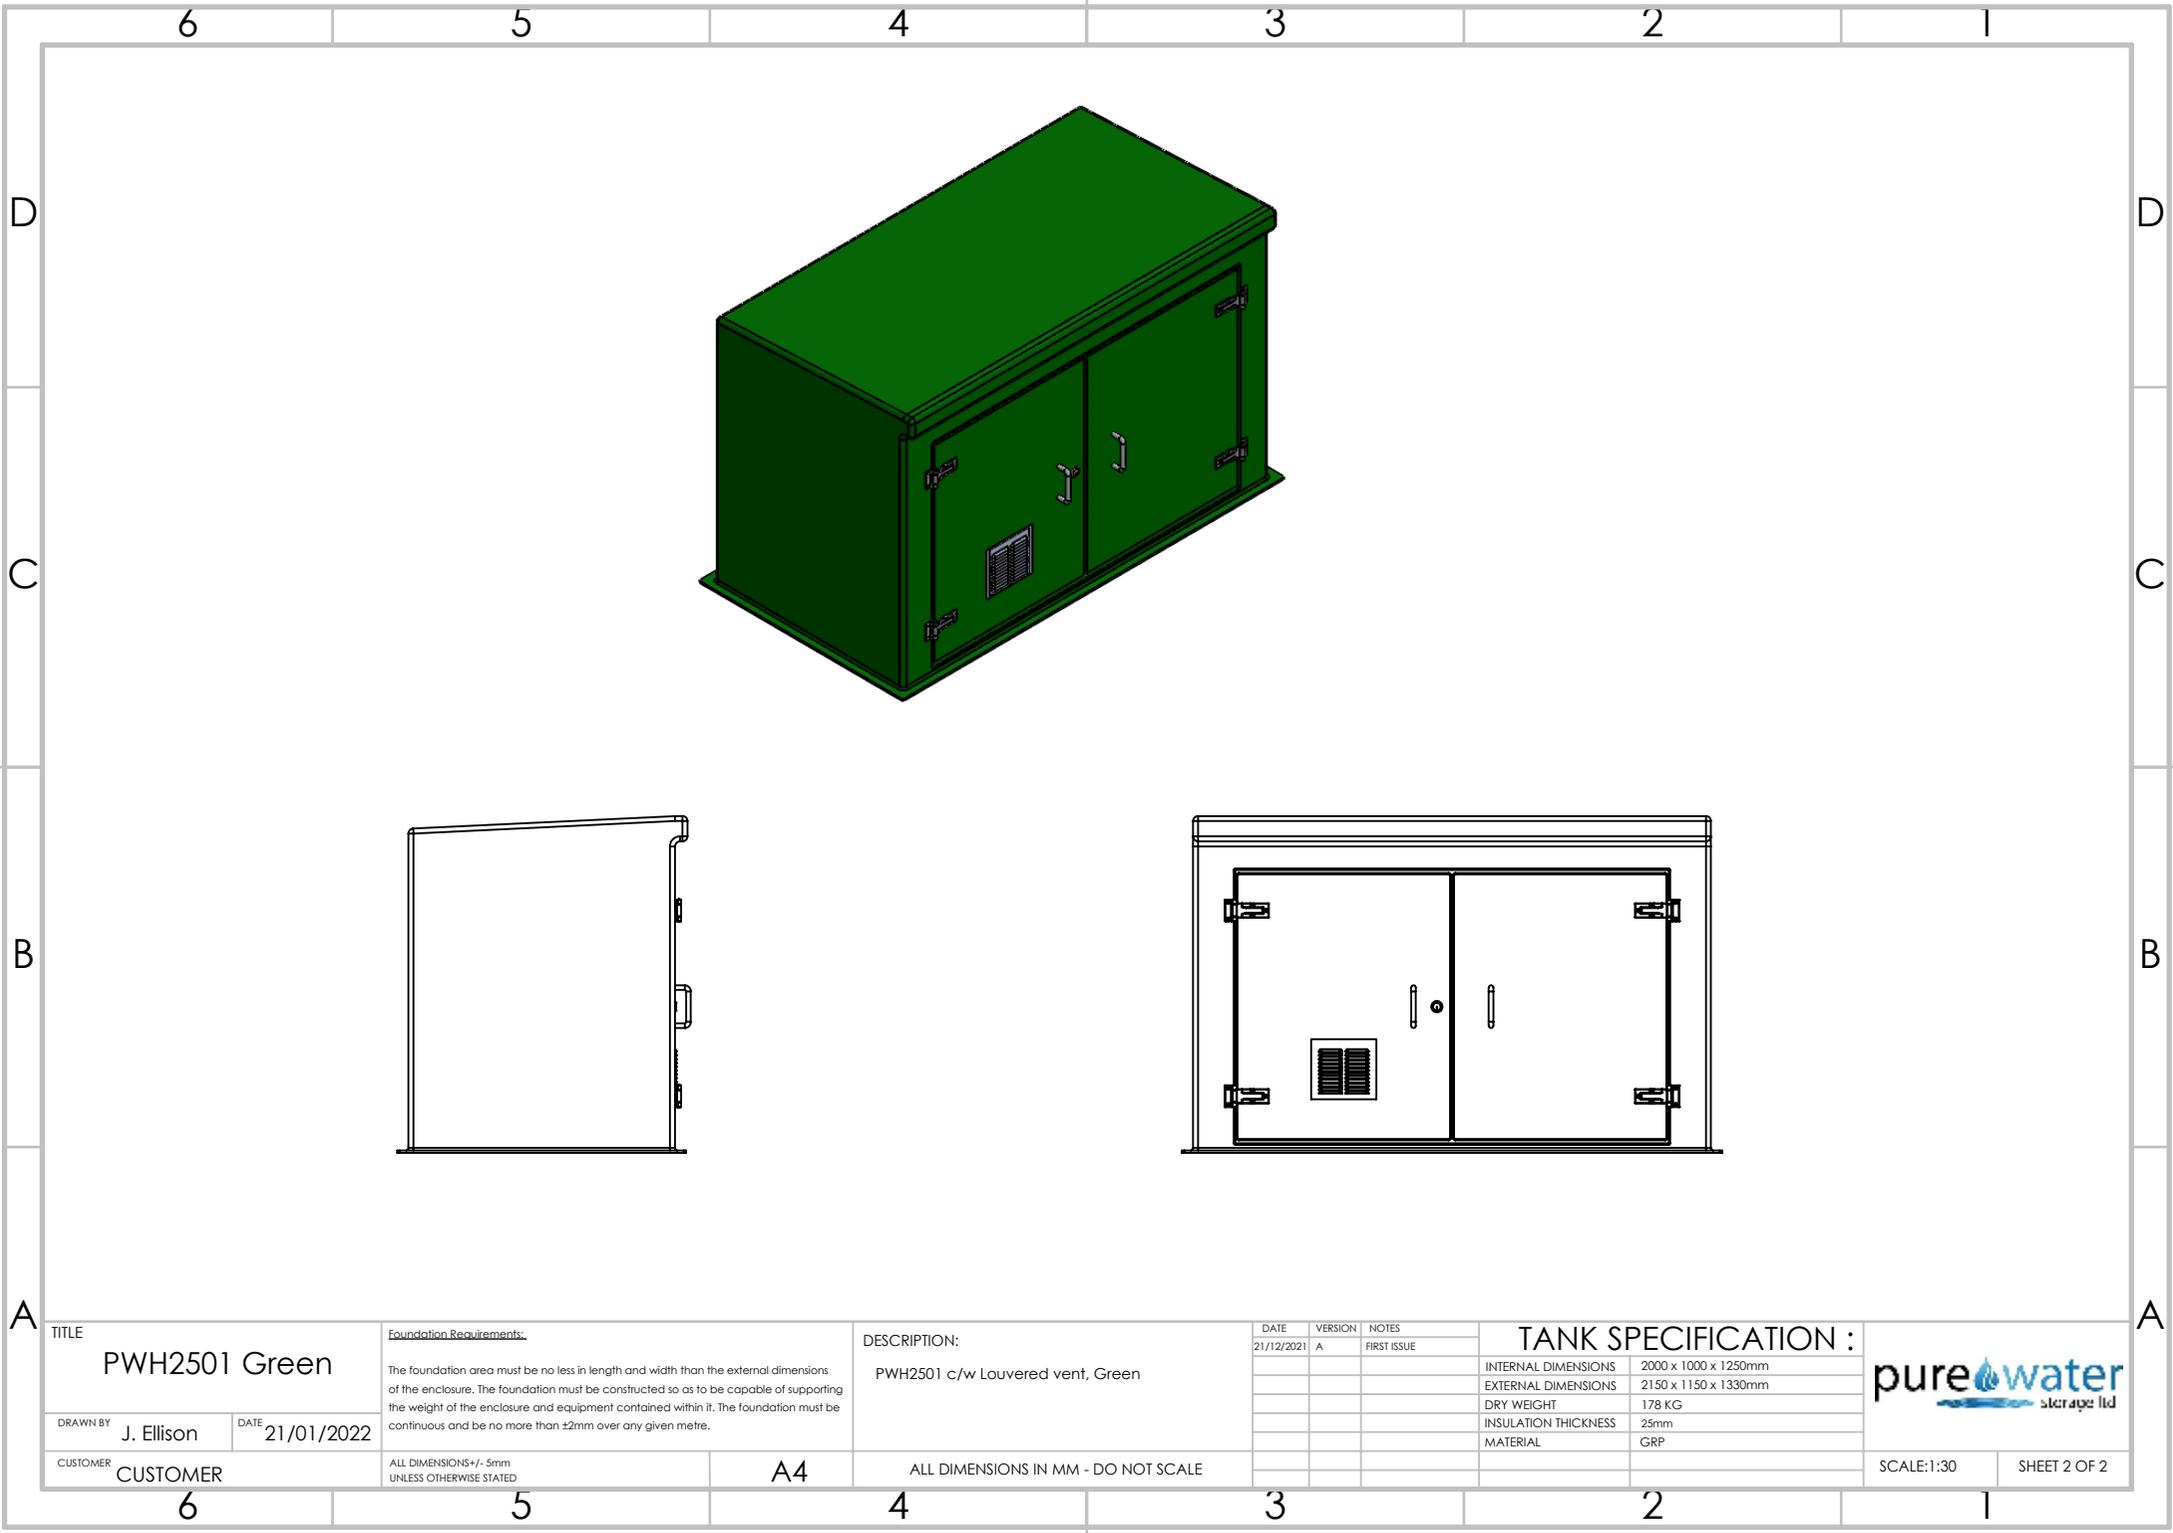

TITLE
PWH2501 Green

DRAWN BY
 J. Ellison

DATE
 21/01/2022

CUSTOMER
 CUSTOMER

Foundation Requirements:
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

ALL DIMENSIONS +/- 5mm
 UNLESS OTHERWISE STATED

DESCRIPTION:
 PWH2501 c/w Louvered vent, Green

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE	VERSION	NOTES
21/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :

INTERNAL DIMENSIONS	2000 x 1000 x 1250mm
EXTERNAL DIMENSIONS	2150 x 1150 x 1330mm
DRY WEIGHT	178 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP

purewater storage ltd

SCALE:1:30

SHEET 2 OF 2