

TITLE
CUCOMP.5625-2250

DRAWN BY J. Ellison DATE 02/03/2022

CUSTOMER CUSTOMER

NOTE:
All Purewater tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

A4

DESCRIPTION:
CUCOMP.5625-2250.AG Airgap Combination Unit


ALL DIMENSIONS IN MM DO NOT SCALE

| DATE | VERSION | NOTES |
|------------|---------|-------------|
| 02/03/2022 | A | FIRST ISSUE |
| | | |
| | | |
| | | |
| | | |

| TANK SPECIFICATION : | | |
|----------------------|----------------------|--|
| WET COMPARTMENT | 1000 x 1500 x 1500mm | |
| DRY COMPARTMENT | 1500 x 1500 x 1500mm | |
| EXTERNAL DIMENSIONS | 2705 x 1705 x 1623mm | |
| NOMINAL CAPACITY | 2250 Litres | |
| INSULATION THICKNESS | 25mm | |
| MATERIAL | GRP | |

purewater storage ltd

SCALE:1:35 SHEET 1 OF 2

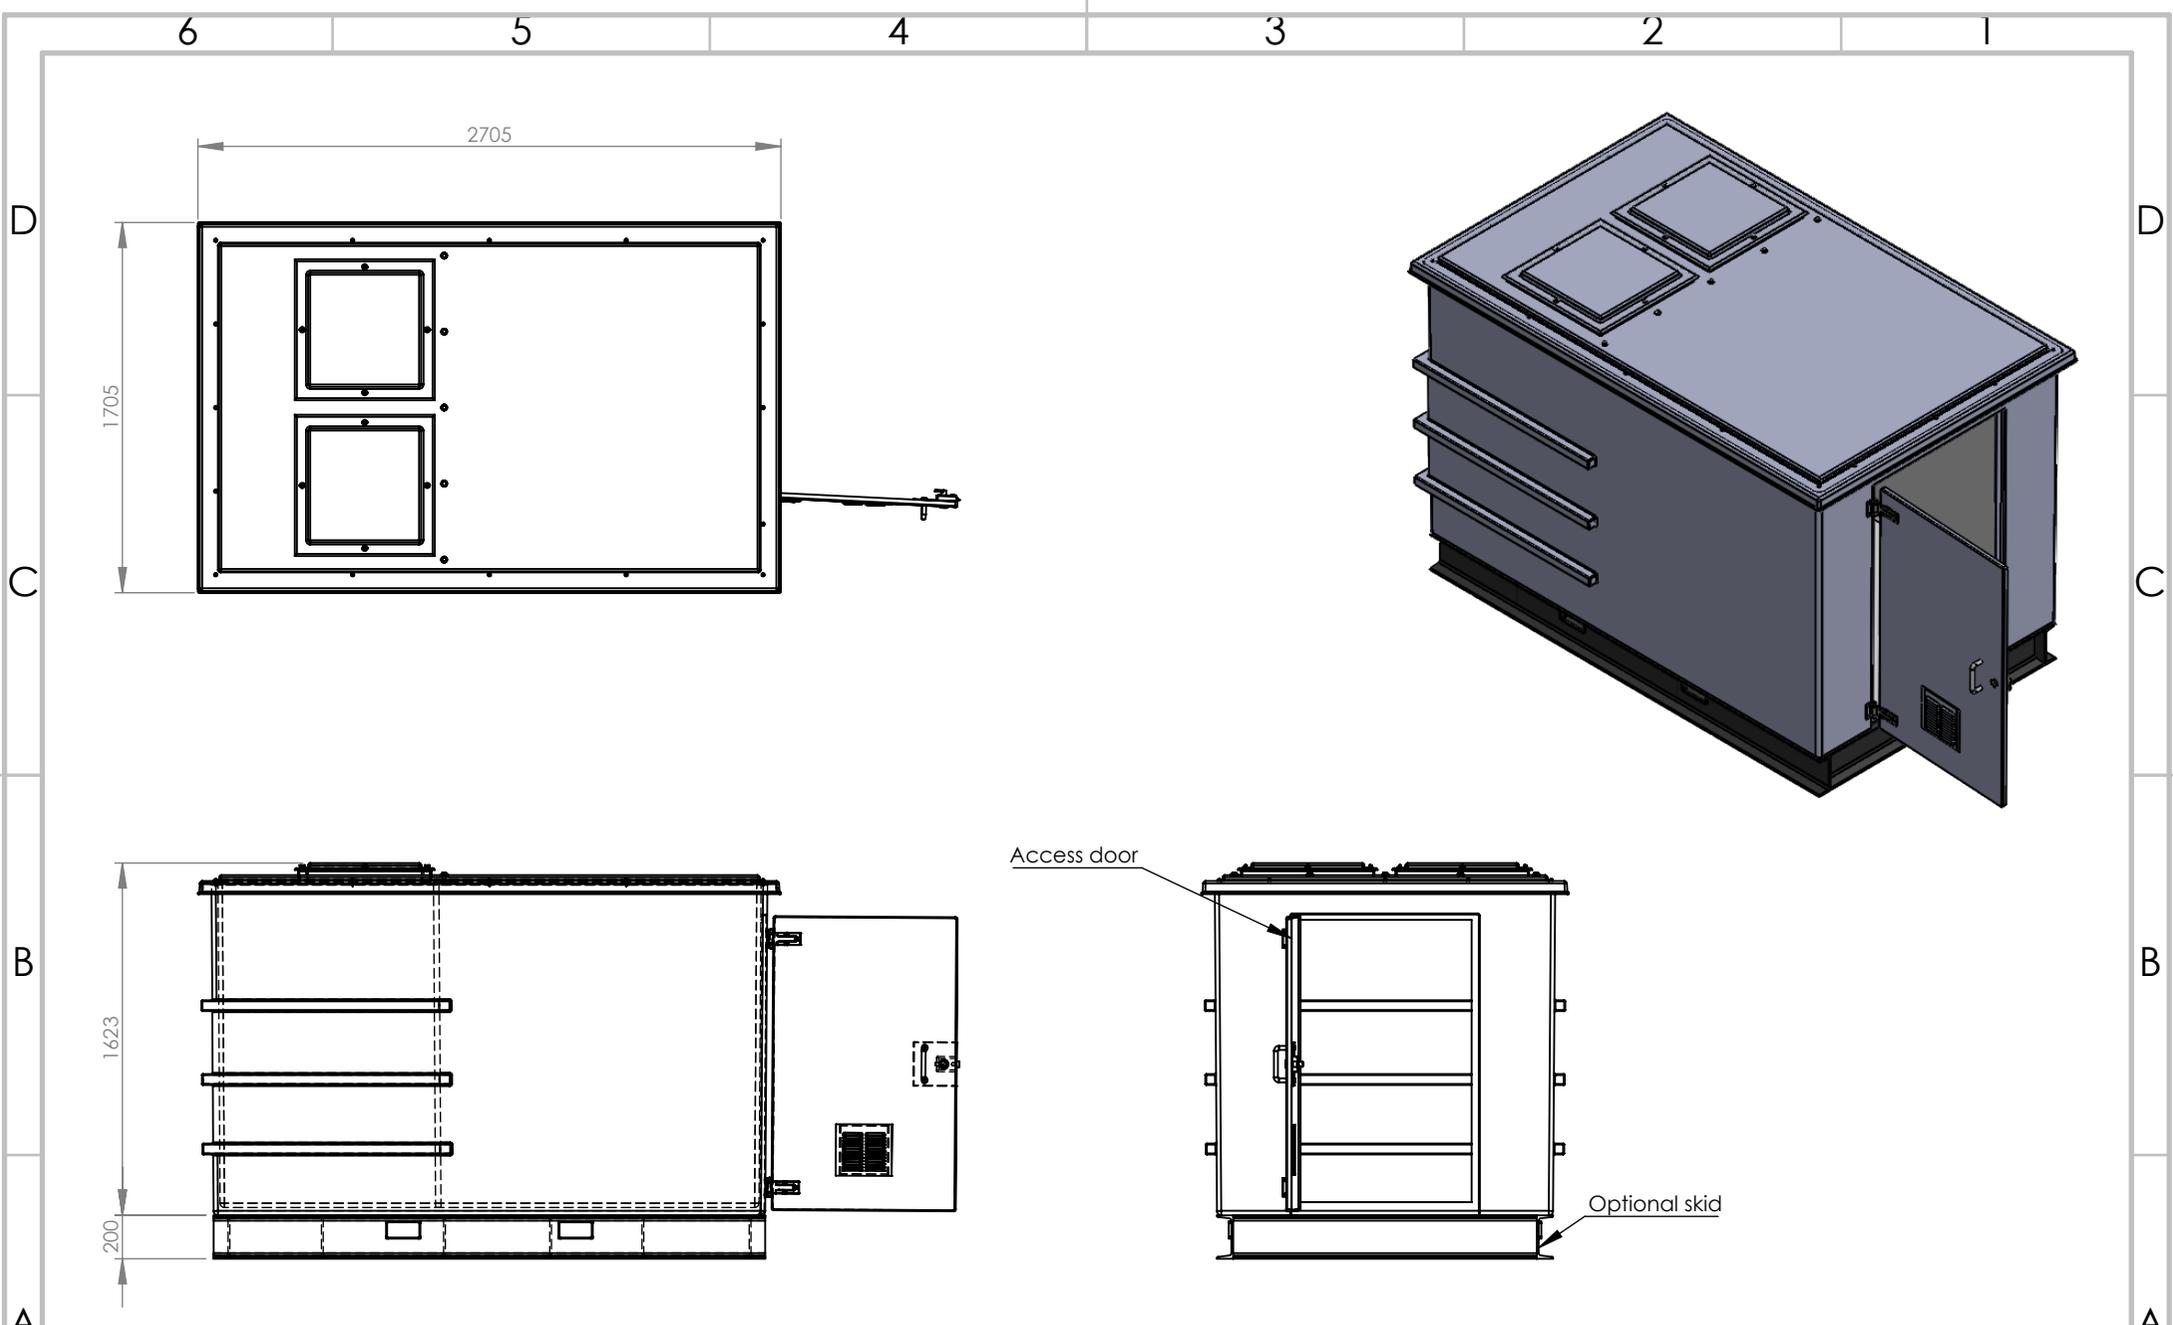

TITLE
CUCOMP.5625-2250
 c/w skid

DRAWN BY **J. Ellison** DATE **02/03/2022**
 CUSTOMER **CUSTOMER**

NOTE:
 All Purewater tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

ALL DIMENSIONS +/- 5mm
 UNLESS OTHERWISE STATED

DESCRIPTION:
CUCOMP.5625-2250.AG Airgap Combination Unit c/w steel skid

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

| DATE | VERSION | NOTES |
|------------|---------|-------------|
| 02/03/2022 | A | FIRST ISSUE |
| | | |
| | | |
| | | |
| | | |
| | | |

| TANK SPECIFICATION : | | |
|----------------------|----------------------|--|
| WET COMPARTMENT | 1000 x 1500 x 1500mm | |
| DRY COMPARTMENT | 1500 x 1500 x 1500mm | |
| EXTERNAL DIMENSIONS | 2705 x 1705 x 1823mm | |
| NOMINAL CAPACITY | 2250 Litres | |
| INSULATION THICKNESS | 25mm | |
| MATERIAL | GRP | |

purewater storage ltd

SCALE:1:35 SHEET 2 OF 2