

6





5

4

3

2

1

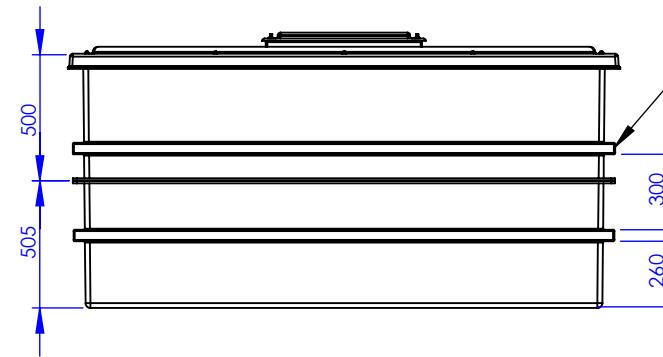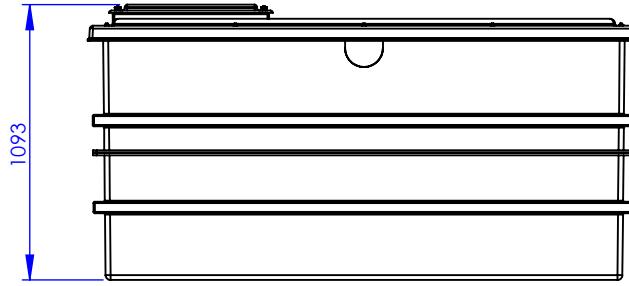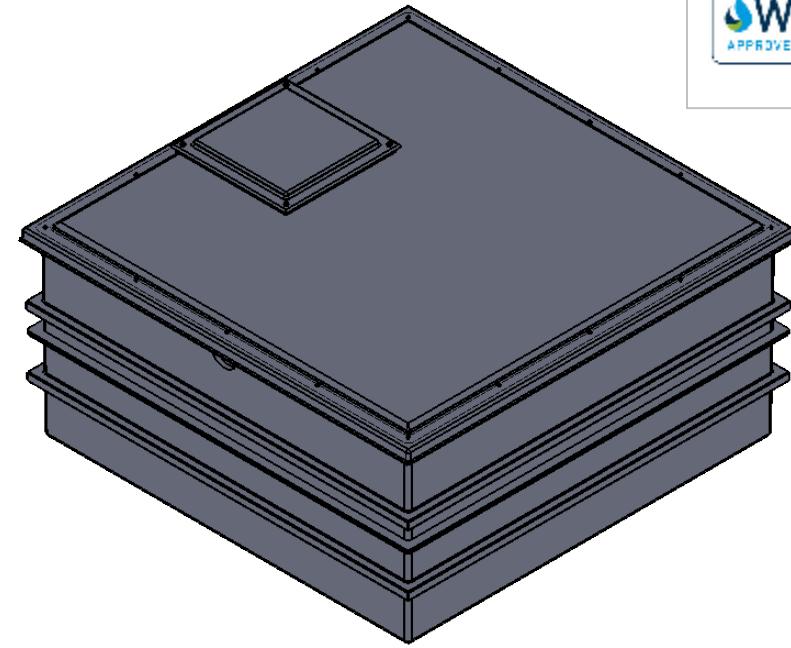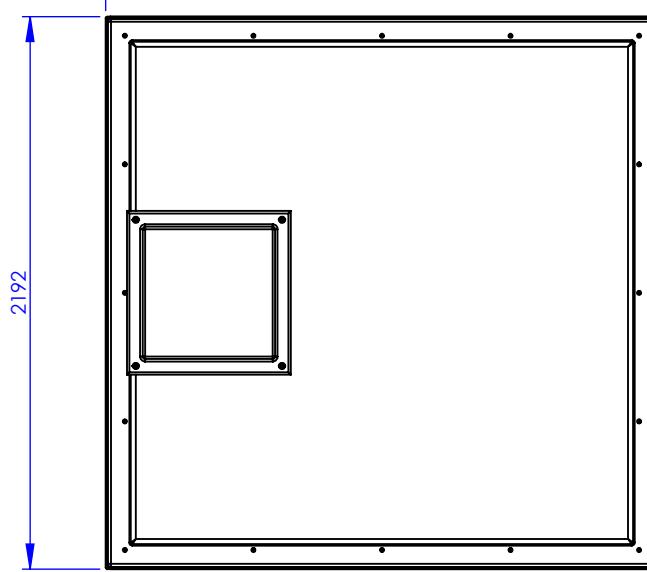

A

TITLE
PW4000.INS-2.AG

NOTE:

All Purewater tanks must be fully supported on a flat, level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

DRAWN BY C.MORRIS DATE 19/01/2024

CUSTOMER

ALL DIMENSIONS +/- 5mm
UNLESS OTHERWISE STATED

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

TANK SPECIFICATION :

DATE	VERSION	NOTES	
27/10/2017	A	FIRST ISSUE	
			INTERNAL DIMENSIONS 2000 x 2000 x 1000mm
			EXTERNAL DIMENSIONS 2192 x 2192 x 1093mm
			NOM. CAPACITY 4000 Litres
			DRY WEIGHT 219 KG
			INSULATION THICKNESS 25mm
			WRAS CERT. NUMBER 131006
			MATERIAL GRP

SCALE:1:30 SHEET 1 OF 1

6

5

4

3

2

1

A

D

C

B

A